

# City of Goshen Utilities Department

## Water Service Calculation Sheet

Customer Name:

Customer Address:

Service Address:

No. of Fixtures	Fixture Valve at psi	Fixture Value
<input type="text"/> Drinking Fountain - Public	=	0
<input type="text"/> Faucet (Lavatory)	=	0
<input type="text"/> Faucet (Kitchen)	=	0
<input type="text"/> Faucet (Utility Sink)	=	0
<input type="text"/> Wash Sink (Each Set of Faucets)	=	0
<input type="text"/> Service Sink	=	0
<input type="text"/> Dishwasher	=	0
<input type="text"/> Showerhead (Shower Only)	=	0
<input type="text"/> Bathtub	=	0
<input type="text"/> Toilet - Flush Valve	=	0
<input type="text"/> Toilet - Tank Type	=	0
<input type="text"/> Urinal - Pedestal Flush Valve	=	0
<input type="text"/> Urinal - Wall Flush Valve	=	0
<input type="text"/> Washing Machine	=	0
<input type="text"/> Hose (50 ft Wash Down) - 1/2 in.	=	0
<input type="text"/> Hose (50 ft Wash Down) - 5/8 in.	=	0
<input type="text"/> Hose (50 ft Wash Down) - 3/4 in.	=	0
<input type="text"/> <u>Miscellaneous</u>		
<input type="text"/> Bedpan Washer	=	0
<input type="text"/> Bidet	=	0
<input type="text"/> Dental Unit	=	0
<b>Combined Fixture Value Total</b>	=	<u><u>0.0</u></u>
Customer Peak Demand (Figure 4-2 or 4-3 x Pressure Factor) ( Note: The pressure factor is included in the fixture value)	=	<input type="text"/> gpm
Added Fixed Load	=	<input type="text"/> gpm
<b>Total Fixed Demand</b>	=	<u>0 gpm</u>

# City of Goshen Utilities Department Water Service Calculation Sheet

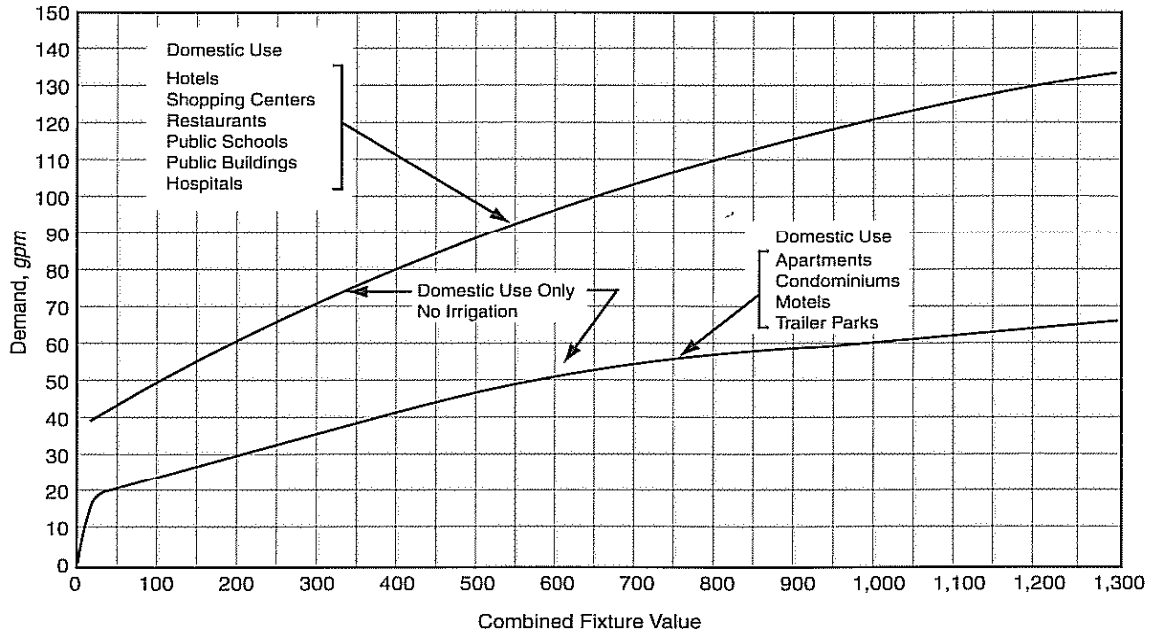


Figure 4-2 Water flow demand per fixture value—low range

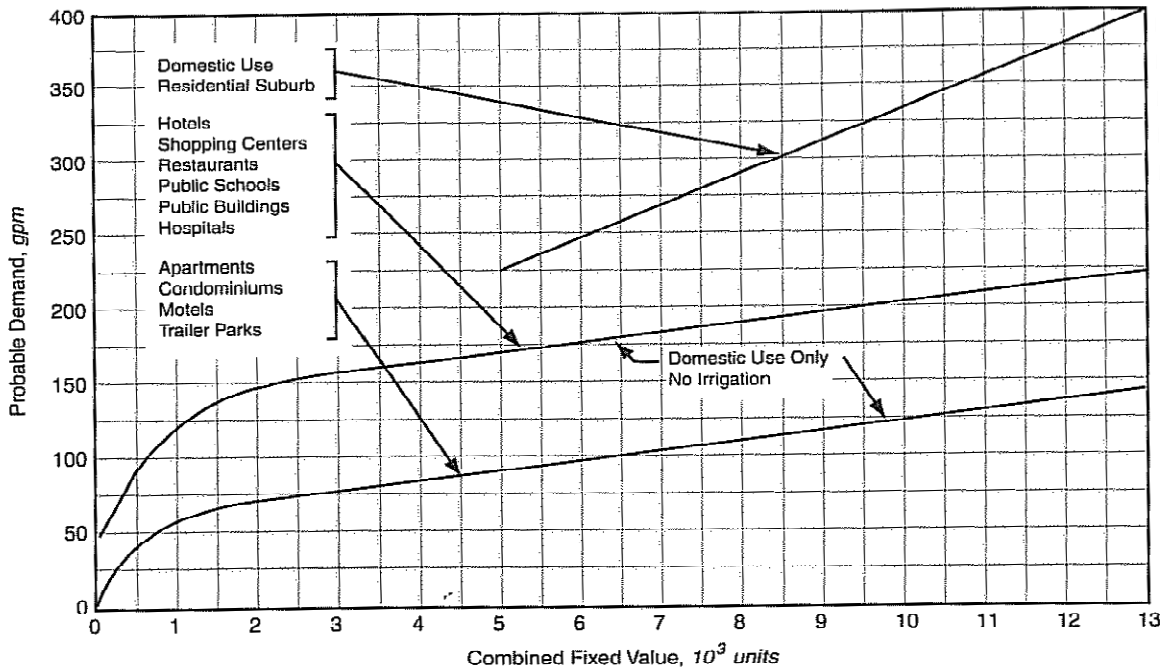


Figure 4-3 Water flow demand per fixture value—high range

Note: Figure 4.2 & 4.3 copied from AWWA Manual M22 "Sizing Water Service Lines and Meters"