
NEENAH R-1772 W/ TYPE 'B' LID OR APPROVED EQUAL. INSTALL TOP OF **CASTING 1/4" BELOW FINISHED** PAVEMENT. FLUSH WITH FINISHED GRADE IN YARD/LANDSCAPED AREAS

## NOTE:

- 1. ALL STRUCTURES MUST BE INSPECTED BY A CITY REPRESENTATIVE PRIOR TO INSTALLATION. STRUCTURES WILL BE REJECTED IF REINFORCING STEEL IS EXPOSED, EXCESSIVE VOIDS ARE OBSERVED IN THE CONCRETE, DAMAGE TO CONCRETE EDGES **BETWEEN SECTIONS AND ANY OTHER ITEM** THAT MAY COMPROMISE THE STRUCTURE
- 2. SEE DETAIL SW-201 FOR ADDITIONAL STRUCTURE INFORMATION

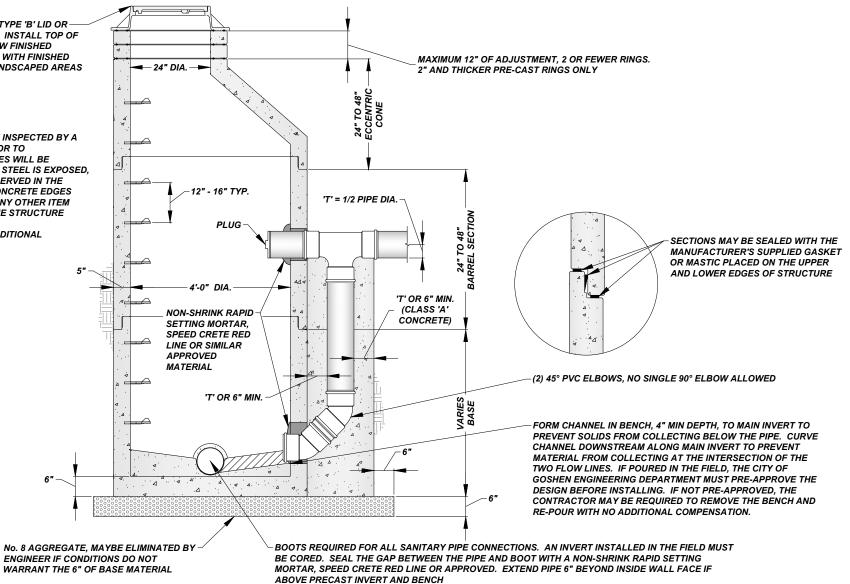

## SEWER EXTERIOR DROP MANHOLE (TYPE D) - CONE W/ MANHOLE CASTING

NOT TO SCALE