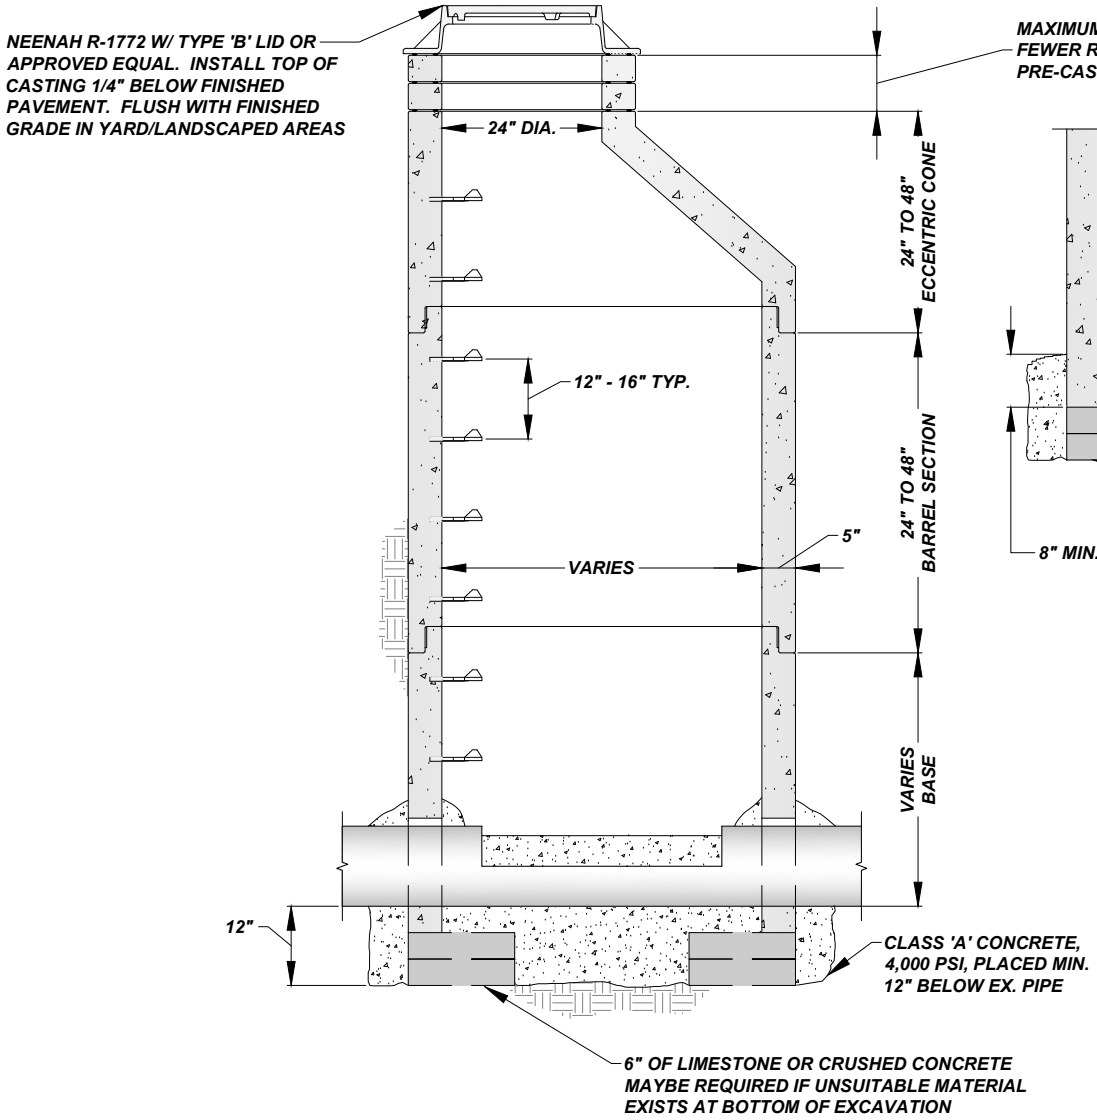

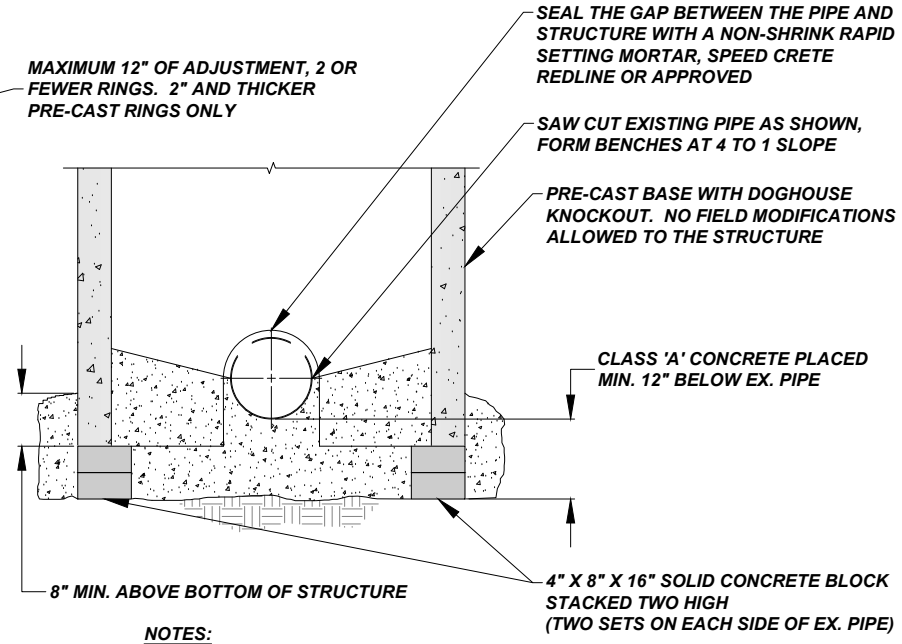

NOTES:

1. ALL STRUCTURES MUST BE INSPECTED BY A CITY REPRESENTATIVE PRIOR TO INSTALLATION. STRUCTURES WILL BE REJECTED IF REINFORCING STEEL IS EXPOSED, EXCESSIVE VOIDS ARE OBSERVED IN THE CONCRETE, DAMAGE TO CONCRETE EDGES BETWEEN SECTIONS AND ANY OTHER ITEM THAT MAY COMPROMISE THE STRUCTURE
2. ALL NEW PIPING ABOVE THE MAIN SHALL BE SEALED WITH A GASKET EMBEDDED IN THE PRE-CAST STRUCTURE, OR A NEOPRENE BOOT, OR BY ANOTHER METHOD APPROVED BY THE CITY ENGINEER, SANITARY ONLY
3. THE CENTERLINE OF THE MANHOLE SHALL BE LOCATED OVER THE CENTERLINE OF THE MAIN SEWER, WHENEVER POSSIBLE
4. 6" - 27" SEWER MAIN SIZE USE A 48" DIAMETER STRUCTURE
5. 30" - 42" SEWER MAIN SIZE USE A 60" DIAMETER STRUCTURE
6. THE EXISTING SEWER MAIN SHALL BE SUPPORTED FROM ABOVE WITH SLINGS DURING ALL PHASES OF CONSTRUCTION. SLINGS ARE TO BE REMOVED ONLY AFTER CONCRETE BACKFILL WITHIN THE STRUCTURE HAS CURED
7. SEE DETAIL SW-201 FOR ADDITIONAL STRUCTURE INFORMATION

SEWER DOGHOUSE MANHOLE (TYPE E) - CONE W/ MANHOLE CASTING

NOT TO SCALE