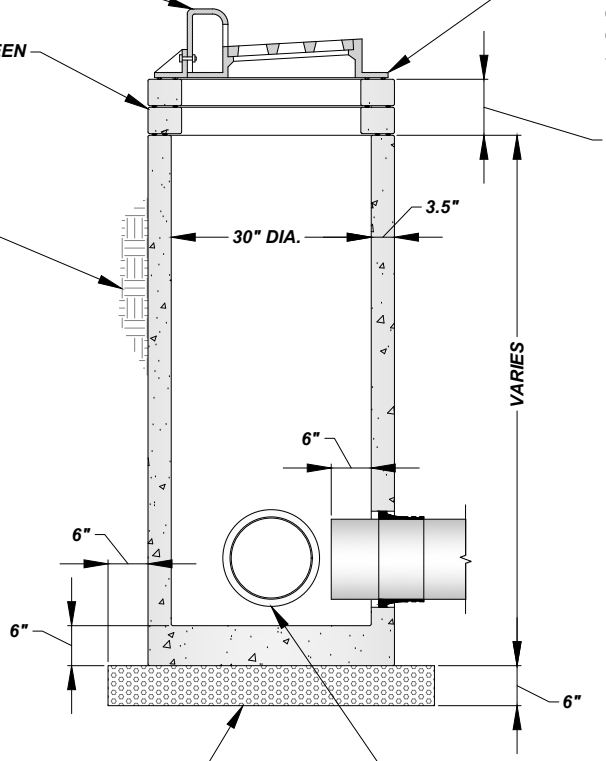

NOTES:

1. *ALL STRUCTURES MUST BE INSPECTED BY A CITY REPRESENTATIVE PRIOR TO INSTALLATION. STRUCTURES WILL BE REJECTED IF REINFORCING STEEL IS EXPOSED, EXCESSIVE VOIDS ARE OBSERVED IN THE CONCRETE, DAMAGE TO CONCRETE EDGES BETWEEN SECTIONS AND ANY OTHER ITEM THAT MAY COMPROMISE THE STRUCTURE*
2. *30" DIA. STRUCTURE SUITABLE UP TO A SINGLE 15" DIA. PIPE*
3. *30" DIA. STRUCTURE SUITABLE UP TO TWO 12" DIA. PIPES AT 90° TO EACH OTHER*
4. *PIPES LARGER THAN 15" DIA. REQUIRE A SEWER MANHOLE STRUCTURE*

SEWER INLET (TYPE N) - CURB CASTING

NOT TO SCALE