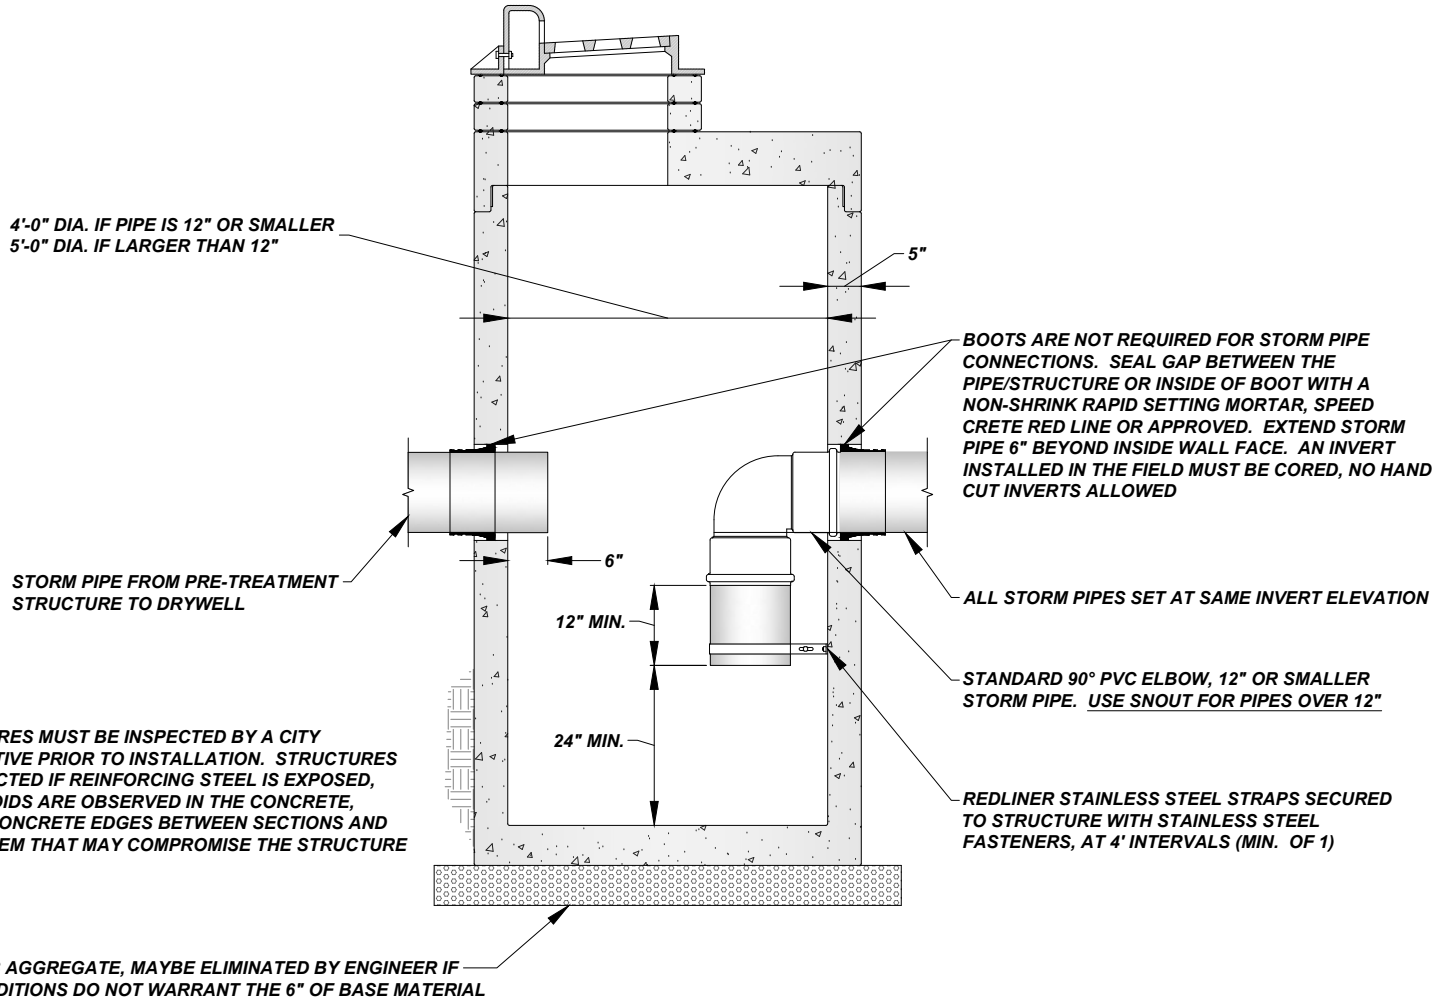

LL STRUCTURES MUST BE INSPECTED BY A CITY
EPRESENTATIVE PRIOR TO INSTALLATION. STRUCTURES
ILL BE REJECTED IF REINFORCING STEEL IS EXPOSED,
XCESSIVE VOIDS ARE OBSERVED IN THE CONCRETE,
AMAGE TO CONCRETE EDGES BETWEEN SECTIONS AND
NY OTHER ITEM THAT MAY COMPROMISE THE STRUCTURE

PRE-TREATMENT STRUCTURE (STANDARD CB W/ 90° ELBOW)

NOT TO SCALE