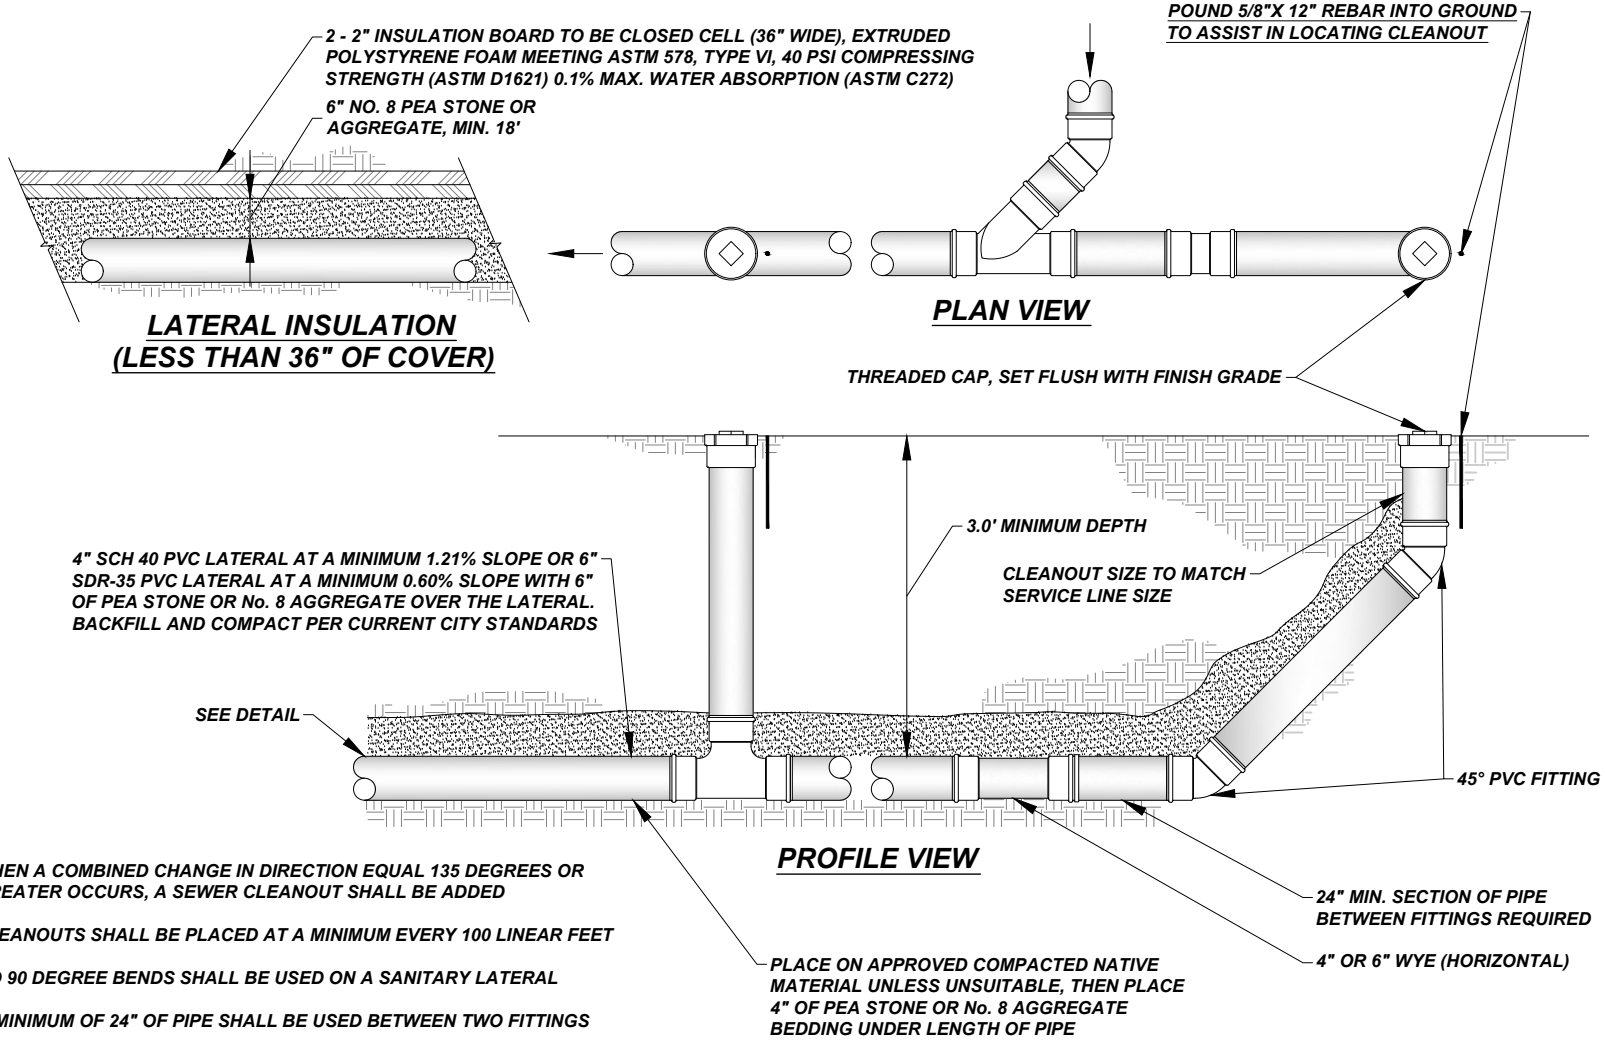

NOTES:

1. WHEN A COMBINED CHANGE IN DIRECTION EQUAL 135 DEGREES OR GREATER OCCURS, A SEWER CLEANOUT SHALL BE ADDED
2. CLEANOUTS SHALL BE PLACED AT A MINIMUM EVERY 100 LINEAR FEET
3. NO 90 DEGREE BENDS SHALL BE USED ON A SANITARY LATERAL
4. A MINIMUM OF 24" OF PIPE SHALL BE USED BETWEEN TWO FITTINGS

SEWER LATERAL OUTSIDE RIGHT-OF-WAY

NOT TO SCALE