


NOTES:

1. USE RESILIENT WEDGE GATE VALVES ON WATER MAINS UNDER 12" IN DIAMETER
2. MATERIAL TO BE DUCTILE IRON
3. WATER VALVES GREATER THAN 6' IN DEPTH REQUIRE A 1" SHAFT EXTENSION WITH 2" TOP NUT, CENTERING RING AND BOTTOM SET SCREW OR PIN

5.0' MIN. COVER
6.0' MAX. COVER

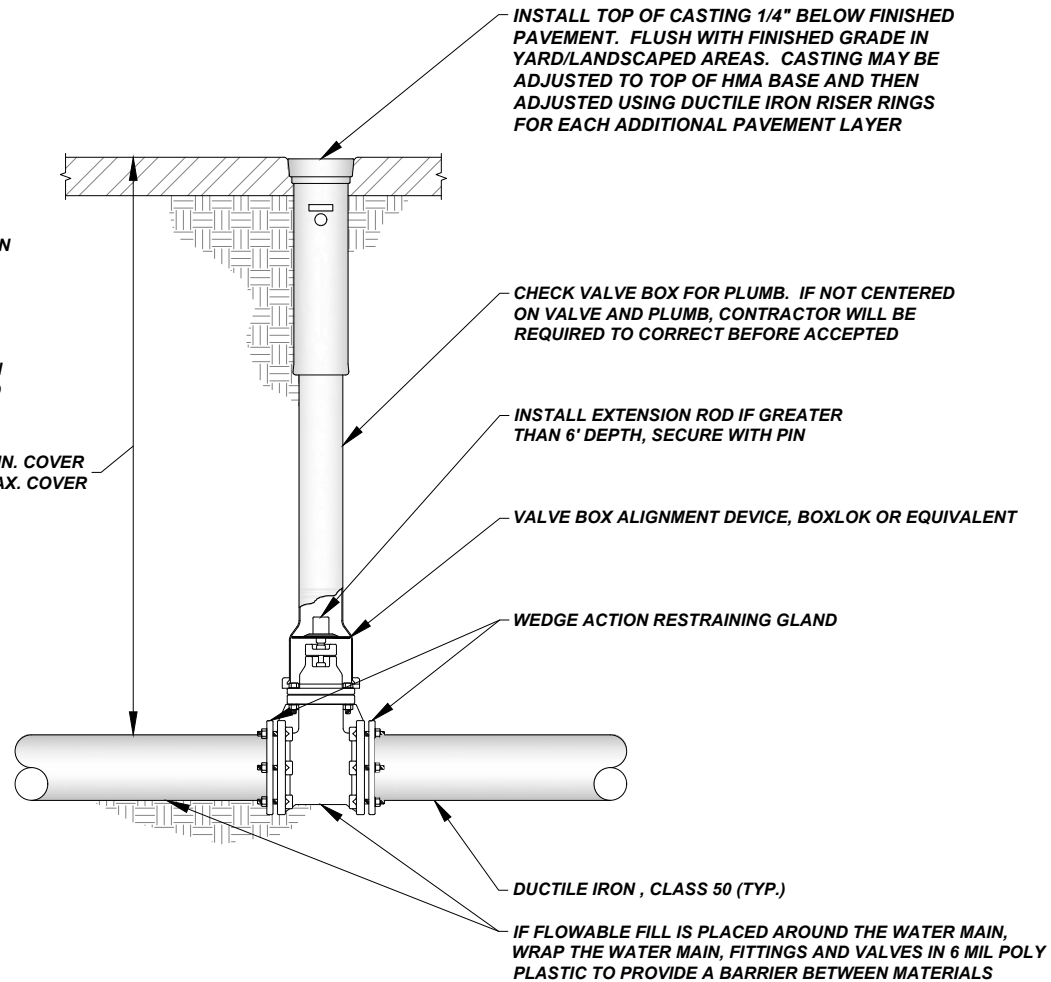

RESILIENT WEDGE GATE VALVE

NOT TO SCALE

The City Of Goshen
Department of Public Works & Safety
Office of Engineering

204 East Jefferson, Suite 1 Street, Goshen, Indiana 46528
Phone: 574-534-2201 Fax: 574-533-8626
Web: goshenindiana.org

Date Approved By The City Of Goshen Board Of Public Works & Safety and Approved Revisions

03/27/2025

CITY OF GOSHEN, INDIANA
STANDARD DETAIL

Drafted By: J. Hoffman
Approved By: D. Sailor, P.E.

Drawing Number:
WA-301