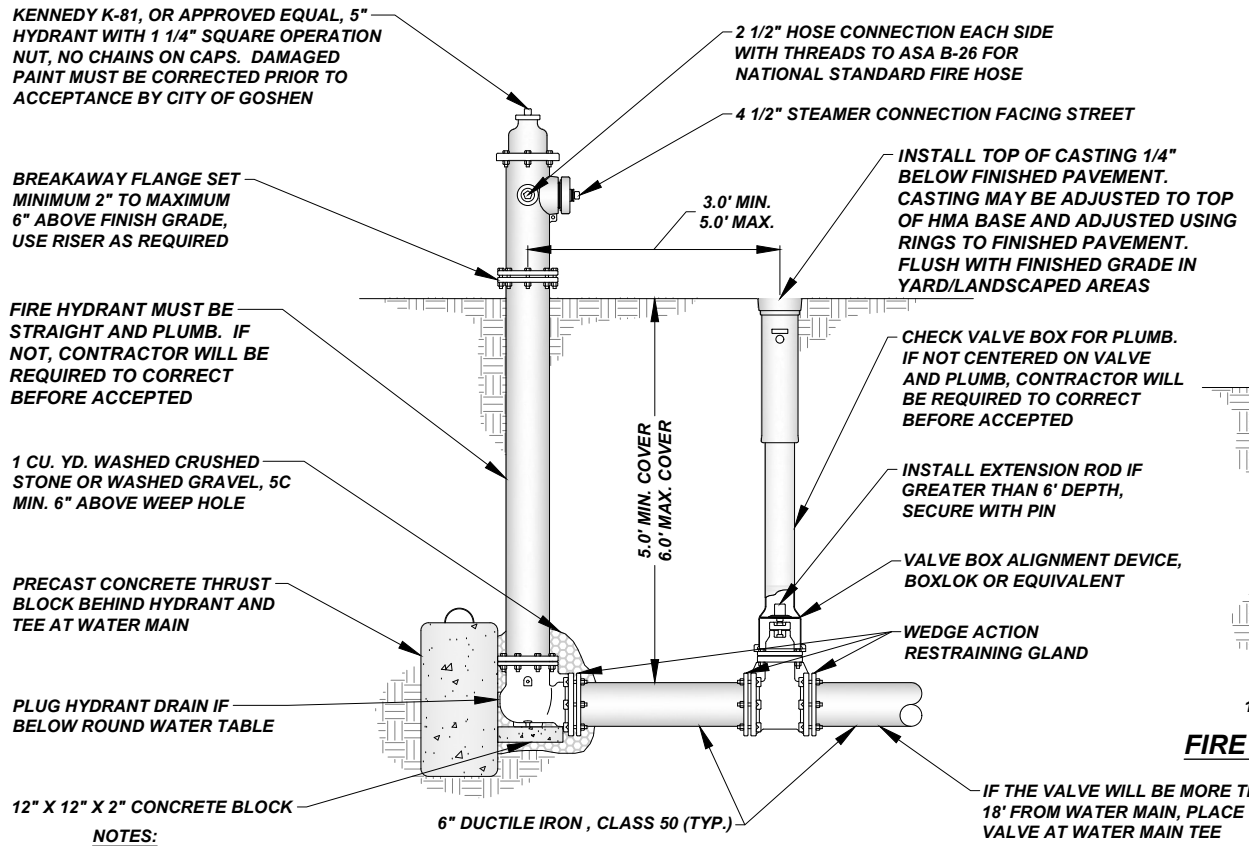

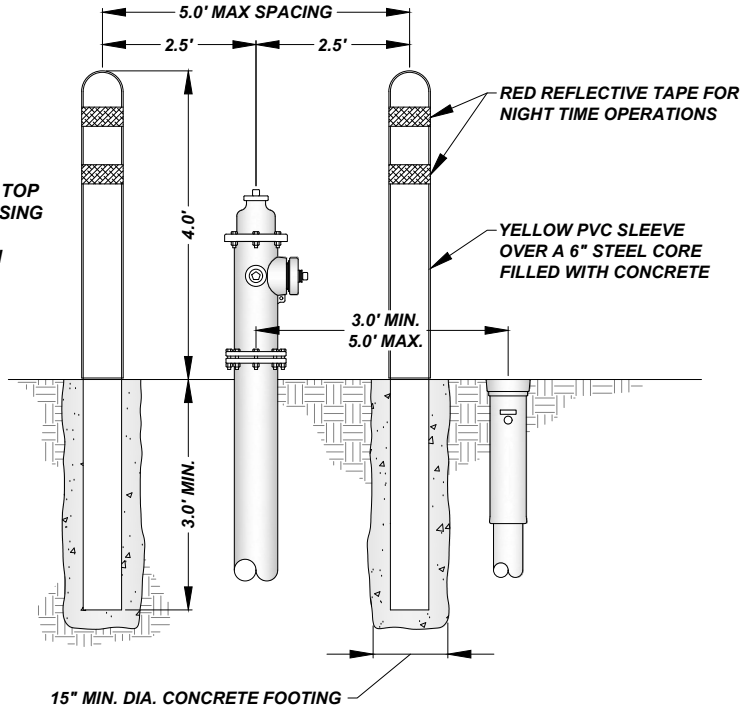

FIRE HYDRANT ASSEMBLY WITH BOLLARDS

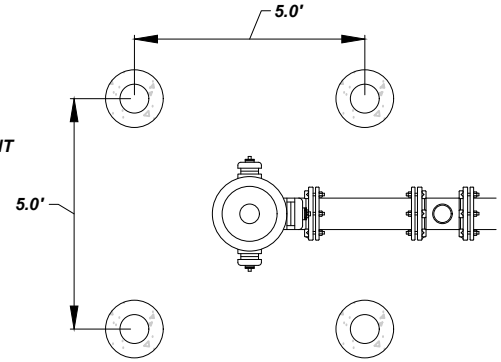

PLAN VIEW

NOTES:

1. FIRE HYDRANT SHALL BE MIN. 1.0' FROM PROPERTY LINE, MIN. 3.0' FROM BACK OF CURB AND/OR MIN. 2.0' FROM SIDEWALK
2. FIRE HYDRANT ASSEMBLY TO INCLUDE TEE AT WATER MAIN, ALL CONNECTING PIPE AND FITTINGS, AUXILIARY GATE VALVE AND BOX AND FIRE HYDRANT
3. GUARD POSTS ARE TO PROTECT A FIRE HYDRANT IN AREAS WHERE VEHICULAR OR EQUIPMENT TRAFFIC MAY BE ENCOUNTERED. REQUIREMENT DETERMINED BY CITY OF GOSHEN
4. NO STRUCTURES, POLES, SIGN POSTS, TREES OR SHRUBS TO BE INSTALLED WITHIN 4.0' OF FIRE HYDRANT
5. PRIVATE HYDRANT COLOR = RED
   PUBLIC HYDRANT COLOR = YELLOW
6. ACCEPTED FIRE HYDRANTS: CLOW MEDALLION AND KENNEDY K81D
7. SEE DETAILS RD-206 AND RD-207 FOR FIRE HYDRANT LOCATION

The City Of Goshen
Department of Public Works & Safety
Office of Engineering

204 East Jefferson, Suite 1 Street, Goshen, Indiana 46528
Phone: 574-534-2201 Fax: 574-533-8626
Web: goshenindiana.org

FIRE HYDRANT ASSEMBLY

NOT TO SCALE

Date Approved By The City Of Goshen Board Of Public Works & Safety and Approved Revisions					
03/27/2025					

CITY OF GOSHEN, INDIANA
STANDARD DETAIL

Drafted By:	Approved By:
J. Hoffman	D. Sailor, P.E.

Drawing Number:
WA-401