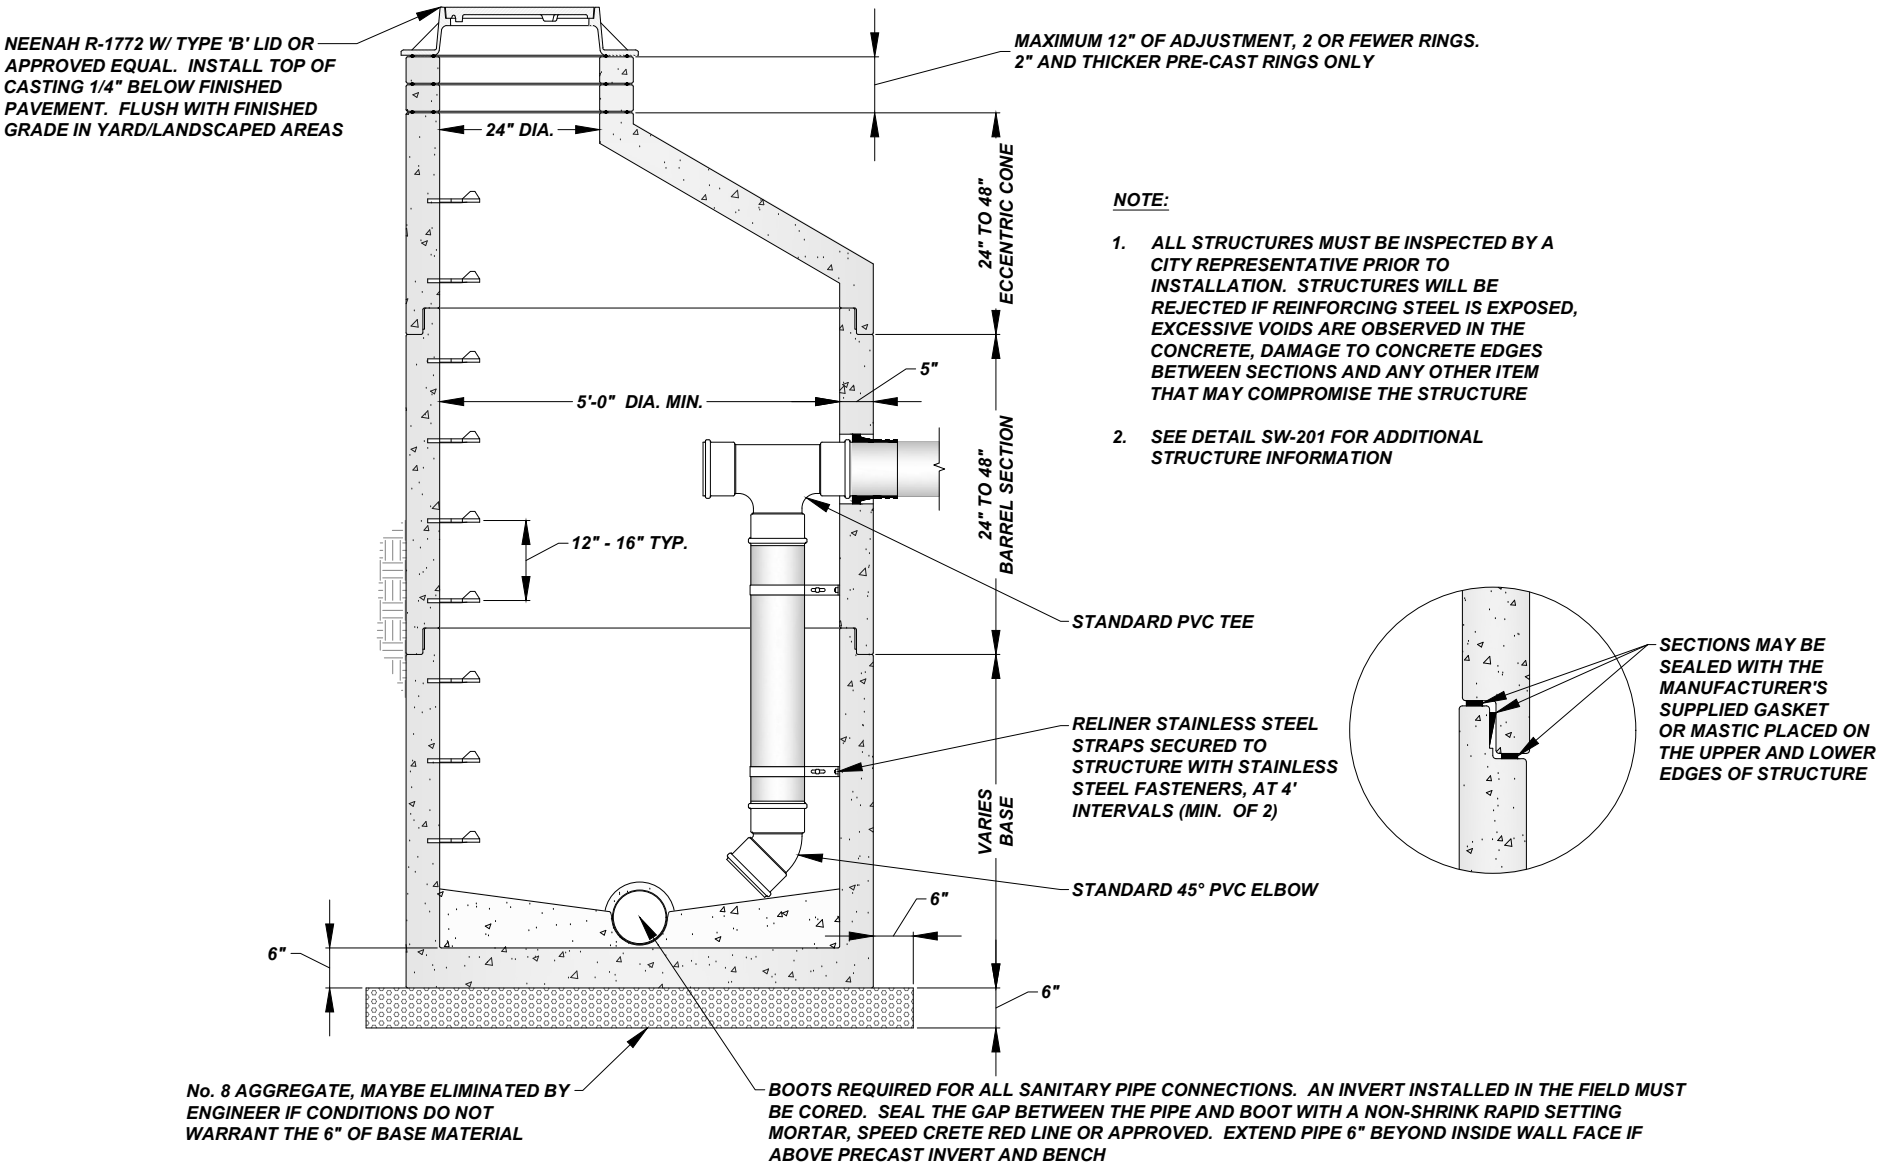

NOTE:

1. ALL STRUCTURES MUST BE INSPECTED BY A CITY REPRESENTATIVE PRIOR TO INSTALLATION. STRUCTURES WILL BE REJECTED IF REINFORCING STEEL IS EXPOSED, EXCESSIVE VOIDS ARE OBSERVED IN THE CONCRETE, DAMAGE TO CONCRETE EDGES BETWEEN SECTIONS AND ANY OTHER ITEM THAT MAY COMPROMISE THE STRUCTURE
2. SEE DETAIL SW-201 FOR ADDITIONAL STRUCTURE INFORMATION

SEWER INTERIOR DROP MANHOLE (TYPE C) - CONE W/ MANHOLE CASTING

NOT TO SCALE